

BLUE WATERS

November 15, 2013

SUSTAINED PETASCALE COMPUTING

National Petascale Computing Facility

LIQUID-COOLED SYSTEMS COMMISSIONING LESSONS LEARNED

THOMAS DURBIN, P.E., LEED AP



GREAT LAKES CONSORTIUM
FOR PETASCALE COMPUTATION

CRAY®



BLUE WATERS


- 288 CRAY CABINETS
- 26,864 COMPUTE NODES
- >49,000 AMD CPUS
- 405,248 CPU CORES
- 4,224 NVIDIA KEPLER GPUS
- 1.5 PETABYTES RAM
- 13.34 PETAFLUPS
- 72 XDP COOLING UNITS
- >95% LIQUID COOLING
- PEAK >3,500 TONS

NPCF

- LEED GOLD CERTIFIED



- PROBLEM STATEMENT:
CONTROL OF CHILLED
WATER FLOW FROM
MULTIPLE SOURCES TO
ONE LOAD WAS
DIFFICULT TO ACHIEVE
BECAUSE OF VARYING
PRESSURES IN THE TWO
SUPPLY PIPES.

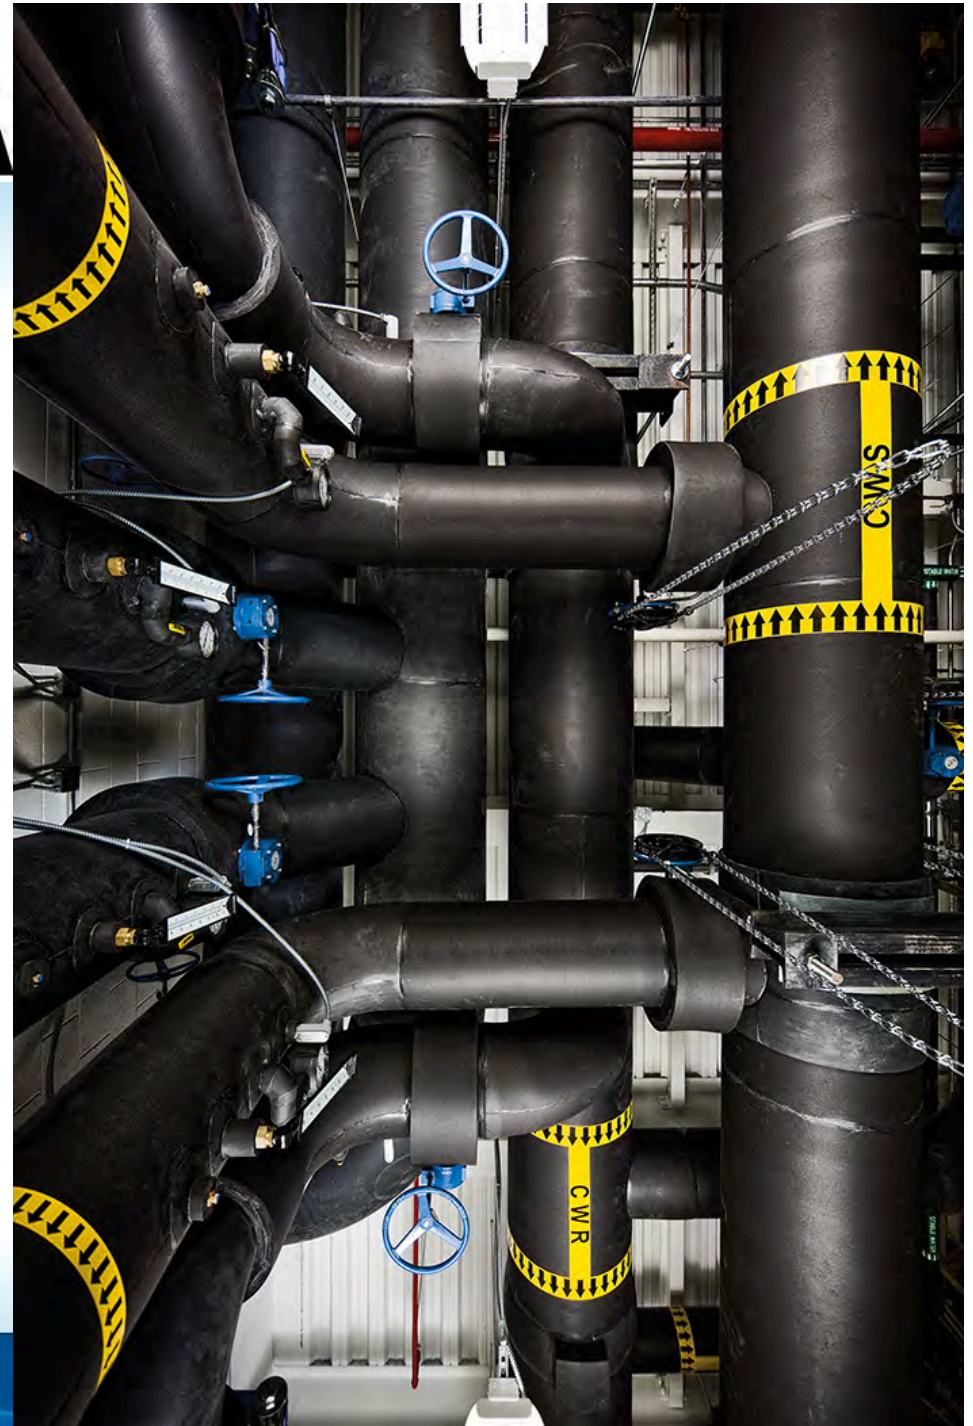

CONSEQUENCES

- WHEN CHILLED WATER FLOW TO THE LOAD IS COMPROMISED, THE HPC SYSTEM REACHES HIGH TEMPERATURE ALARM IN LESS THAN 2 MINUTES AND DEACTIVATES.
- IT TAKES SEVERAL HOURS TO REBOOT THE SYSTEM AND JOBS MUST BE RESTARTED.



ROOT CAUSE

- DIFFERENCES IN SUPPLY PRESSURES WERE TOO LARGE WHEN THE CAMPUS SYSTEM PRESSURE DROPPED, CAUSING A DECREASE IN FLOW TO THE LOAD AND FLOW TO REVERSE IN THE CAMPUS SUPPLY PIPES.

CORRECTIVE ACTIONS

- COORDINATE UTILITY OPERATIONS WITH CAMPUS UTILITY PERSONNEL AND MODIFY THE CONTROLS PROGRAMMING

FORWARD ADOPTION

- INCORPORATED INTO SYSTEMATIC APPROACH FOR UNIVERSAL COMMISSIONING FOR LIQUID-COOLED SYSTEMS



GREAT LAKES CONSORTIUM
FOR PETASCALE COMPUTATION



QUESTIONS

THOMAS DURBIN, P.E., LEED AP
217-333-4024
tedurbin@illinois.edu