

Measuring Energy Efficiency for an HPC Center

Ghaleb Abdulla

LLNL



LLNL-PRES-XXXXXX

This work was performed under the auspices of the U.S. Department of Energy by Lawrence Livermore National Laboratory under Contract DE-AC52-07NA27344. Lawrence Livermore National Security, LLC



Energy efficiency metrics

$$PUE = \frac{\textit{mechanical} + \textit{computing} + \textit{other}}{\textit{computing}}$$

$$ITUE = \frac{\textit{total energy (that goes into the machine)}}{\textit{energy into the computing nodes}}$$

$$TUE = ITUE * PUE$$

Sequoia Parameters

- IBM Blue Gene*/Q architecture
- 98,304 nodes
- 1,572,864 cores
- 20 PF, 3rd on Top 500 – June 2013
- 96 racks
- 91% liquid cooled
- 30 gpm/rack at 62 F
- 9% air cooled
- 1700 cfm/rack at 70 F
- 4800 square feet
- *Copyright 2013 by International Business Machine Corporation




Sequoia ITUE

- No power from the rack AC connection is used to cool the racks
- Power to cool the racks is in the measured PUE
- Power lost is due to conversion efficiency
- Two levels
 - AC to DC (92.5%)
 - Regulation Module & Transformer (~87%)

92.5% efficiency

87% efficiency

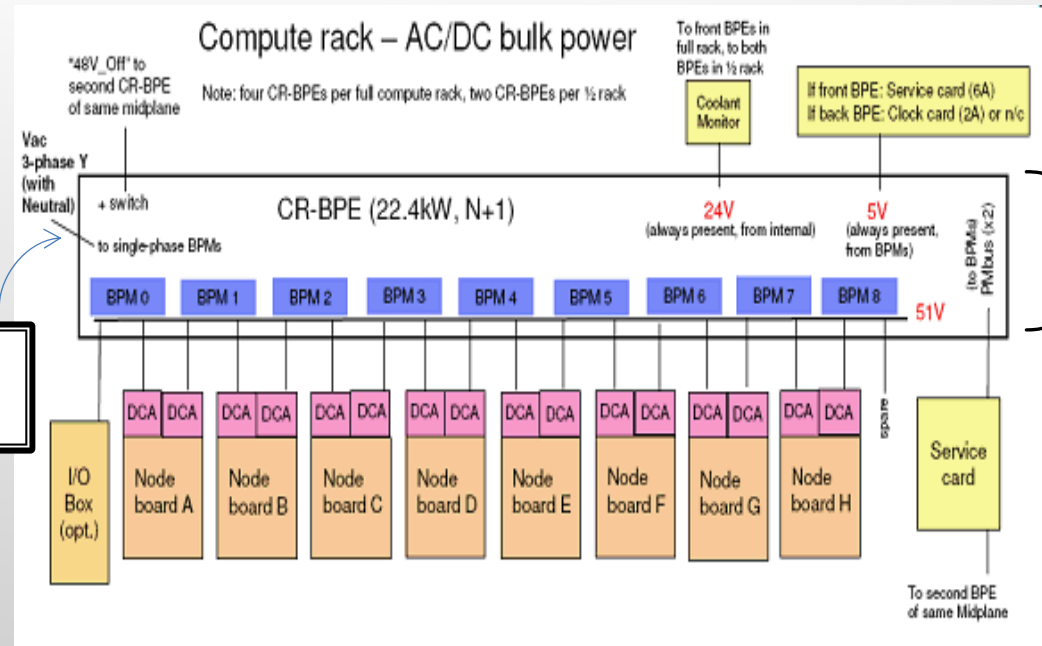

$$\text{ITUE} = \frac{\text{Total Sequoia measured power}}{\text{Total Sequoia compute power}} = \frac{6118}{(6118)(0.925)(0.87)} = 1.24$$

Sequoia TUE

- TUE (Sequoia) = ITUE(Sequoia) x PUE(Facility)
- ITUE (Sequoia) = 1.24
- PUE (Facility) = 1.27



Metric	Measured	Estimated
ITUE		Estimated based on vendor efficiency estimates
PUE	Fully metered per rack, system and facility	

$$\text{TUE} = 1.24 \times 1.27 = 1.57$$

Implement Centralized System

Created an operational, event, and real-time data management infrastructure of all external and internal data sources

Data Sources
Rack, Equipment, Metering, Building Management, Utility

Interfaces
Hundreds of Real Time Data Streams

Manage
Gather and Evaluate Large Amounts of Data

Analyze
Convert Real Time Data

Notify
Centralized Event Notification

Visualize
View Data and Reports

Goal = Lower power utilization without sacrificing Mission

Current data sources spread across LLNL




Data collection and Validation

- Data is collected using the MV-90 meters
 - Power to Sequoia and other HPC machines
 - Mechanical load (chillers, cooling tower, etc.)
- Sequoia power can be collected from the racks meters
 - Verified power from the rack level collection
 - One of the meters was not reporting correctly

PUE Dashboard

- PUE calculated using the metered data (not sequoia rack power)
 - PUE is now a tag in the DB
- High spikes are when Sequoia is down for maintenance
 - Regular maintenance schedule with one major outage
- Daily and weekly cycles

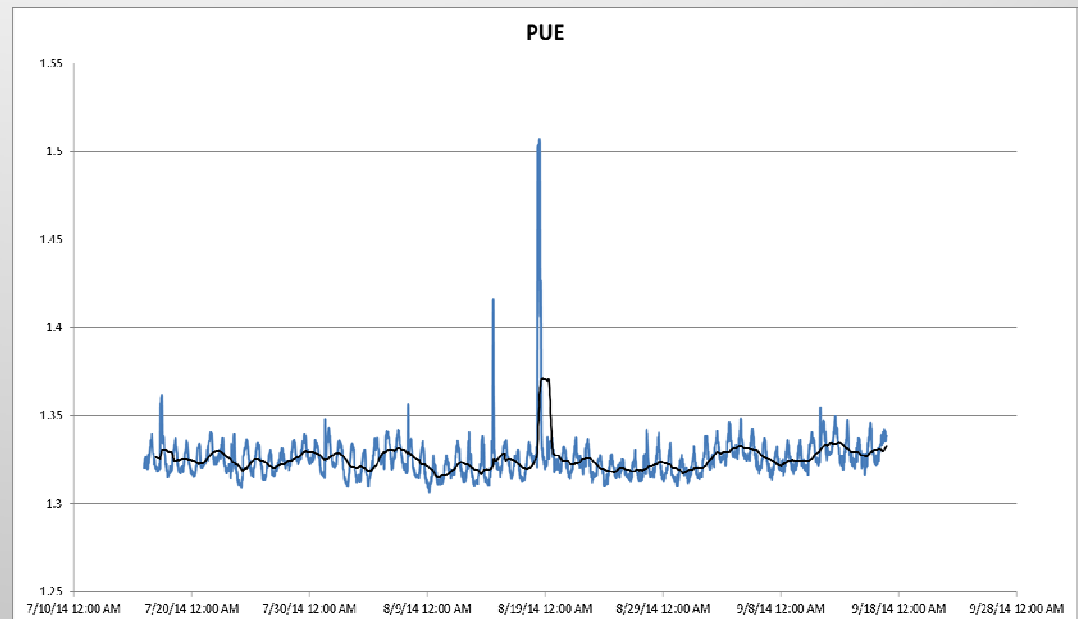

TUE graph for Sequoia

